

A.R.K6B DATA SHEET



SPECIFICATIONS & OPTIONS

Standards

- A.R.K series alternator conforms to the major international standards and specifications, including:
 -IEC60034, GB755, BS5000, VDE0530, NEMA, MG1-22, C22.2-100, CSA, AS1359 standard, etc.
- •A.R.K series alterantor is certified by ISO9001 quality system.
- •A.R.K series alterantor can be used for the generator set of CE mark.
- Other standards and certification can be based on customer requirements

Electrical characteristics

Insualtion & Impregnating

Class H insulation.

All wound components are impregnated with meterial and processes designed specially to provide protection against harsh enviroments encountered in generator application. Resin based meterials are selected and developed to provide the high build required for static windings and the high mechanical strength required for rotating components.

- 3-phase reconnectable with12 ends brought out to the terminals.
- •2/3 pitch , can eliminates triple (3rd, 9th, 15th ...) harmonics on the voltage waveform and is found to be the optimumdesign for trouble-free supply of non-linear loads.
- Telephone interference
- THF(as defined by IEC 60034-1) is less than 2%, TIF(as defined by NEMA MG1-32) is less than 50.
- Brushless device and the high quality AVR ensure low levels of interference with radio transmissions.RFI suppression module may be installed if required.
- High efficiency and motor startup capability.

Mechanical properties

- •Steel structure.
- Cast aluminum for front and rear cover.
- •Rigid assembly, effectively reduces the vibration during running.
- •All rotors are dynamically balanced to conform with BS6861.
- Half key dynamic balance is applied in double bearing structure.
- Non-maintenance sealed-for-life ball bearing.
- •120% overspeed ability.

Standard

Protection grade

- A.R.K series alternator protection level is IP23.
- Suitable for environment with 95% relative humidity.

optional

- -Inlet and filter, power reduced by 5%.
- -Inlet and outlet filter, power reduced by 10% (IP44)
- -Anti-condensation heater.
- -Stator winding, bearing overheating protection.
- -Outlet line design of outlet box.
- -Center height can be customized according to requirements.

Excitation and voltage regulation system

MODEL	16 series	18 series	22 series	27 series	4 series	5 series	6 series	7 series
AVR								
SX460	Standard	Standard	Standard	Standard				
AS440(parallel optional)	Optional	Optional	Optional	Optional				
SX440(parallel optional)			Optional	Optional	Standard	Standard		
MX341(with PMG)			Optional	Optional	Optional	Optional		
MX321(with PMG)							Standard	Standard

With the self-excited system, the main stator provides power via the automatic voltage regulator(AVR) to the exciter stator. The high efficency AVR ensures the voltage maintaining at the rated level. The exciter rotor output is fed to the main rotor through a three phase full wave bridge rectifier. The rectifier is protected by surge suppressor from voltage spikes of short circuit or phase mismatching.

Application

Prime power, rental, telecom, mobile power station, lighting tower, railway, refrigeration and standby power.

Quality assurance

A.R.K series alterantors are manufactured using production procedures having a quality assurance level to ISO 9001.


Note: Continuous development of our products entitles usto change specification details without notice, thereforethey must not be regarded as binding.


A.R.K6B Parameters (WINDING 311)


CONTROL SYSTEM	SELF EXCITED												
A.V.R.	MX341 WITH PMG												
VOLTAGE REGULATION		± 1.0 %											
SUSTAINED SHORT CIRCUIT		>300% OF RATED CURRENT											
INSULATION SYSTEM					Н								
RATED POWER FACTOR		0.8											
PROTECTION					IP2	3							
STATOR WINDING					DOUBLE I	LAYER							
ROTOR WINDING						ING CAGE							
WINDING LEADS					6								
STATOR WDG. RESISTANCE			0.0039 Ohms	PER PHAS	SE AT 22°	C SERIES STAR	CONNECTED						
ROTOR WDG. RESISTANCE					1.6 Ohms	at 22°C							
R.F.I. SUPPRESSION		BS EN	61000-6-2 & BS E	N 61000-6	-4,VDE 08	75G, VDE 0875N	I. refer to factory fo	r others					
WAVEFORM DISTORTION			NO LOAD < 1.5%	NON-DIS	TORTING	BALANCED LIN	EAR LOAD < 5.0%						
MAXIMUM OVERSPEED					2250 Re	ev/Min							
BEARING DRIVE END					BALL. 622	28 (ISO)							
BEARING NON-DRIVE END					BALL. 631	19 (ISO)							
		1 BE/	ARING				2 BEA	ARING					
WEIGHT COMP. GENERATOR		198	85 kg				203	0 kg					
WEIGHT WOUND STATOR		86	5 kg			865 kg							
WEIGHT WOUND ROTOR		76	0 kg			716 kg							
WR2 INERTIA		16.781	6 kgm2				16.238	2 kgm2					
SHIPPING WEIGHTS in a crate		202	23 kg				204	5 kg					
PACKING CRATE SIZE		183 x 92	x 140 (cm)			183 x 92 x 140 (cm)							
	50HZ 60HZ												
TELEPHONE INTERFERENCE		THE	-<2%			TIF<50							
COOLING AIR		2.18 m³/se	ec 4619 cfm			2.63 m³/sec 5573 cfm							
VOLTAGE SERIES STAR	380/220	400/231	415/240	440/2	254	416/240	440/254	460/266	480/277				
VOLTAGE PARALLEL STAR	190/110	200/115	208/120	220/	127	208/120	220/127	230/133	240/138				
VOLTAGE SERIES DELTA	220/110	230/115	240/120	254/	127	240/120	254/127	266/133	277/138				
kVA BASE RATING FOR REACTANCE VALUES	710	750	750	68	0	810	855	895	938				
Xd DIR. AXIS SYNCHRONOUS	2.73	2.60	2.42	1.9	-	3.12	2.94	2.82	2.71				
X'd DIR. AXIS TRANSIENT	0.17	0.16	0.15	0.1		0.20	0.18	0.18	0.17				
X"d DIR. AXIS SUBTRANSIENT	0.12	0.12	0.11	0.0	_	0.14	0.13	0.13	0.12				
Xq QUAD. AXIS REACTANCE	2.27	2.16	2.01	1.6		2.59	2.44	2.34	2.25				
X"q QUAD. AXIS SUBTRANSIENT	0.28	0.27	0.25	0.2		0.32	0.30	0.29	0.28				
X L LEAKAGE REACTANCE	0.10	0.09	0.09	0.0)7	0.11	0.11	0.10	0.10				
X 2 NEGATIVE SEQUENCE	0.20	0.20	0.18	0.1	5	0.23	0.22	0.21	0.20				
X 0 ZERO SEQUENCE	0.03	0.03	0.02	0.0		0.03	0.03	0.03	0.03				
REACTANCES ARE SATURATED			VALUES ARE	PER UNIT	AT RATI	NG AND VOLTAG	GE INDICATED						
T'd TRANSIENT TIME CONST.					0.10	6s							
T"d SUB-TRANSTIME CONST.					0.013								
T'do O.C. FIELD TIME CONST.					2.91								
Ta ARMATURE TIME CONST.	0.035s												
SHORT CIRCUIT RATIO					1/X	d							
EXTATION SYSTEM	Q Y	460	SX440			AS440	MX341		MX321				
VOLTAGE REGULATION RATE		.5%	±1.0%			±1.0%	±1.0%		±0.5%				
LOW SPEED VOLTAGE DROP PROTECTION			Standard			Standard	Standard		Standard				
CHORT CIRCUITED ELECTRIC ARILITY	Standard Standard				3	runuaru			2009/-400				


EXTATION SYSTEM	SX460	SX440	AS440	MX341	MX321
VOLTAGE REGULATION RATE	±1.5%	±1.0%	±1.0%	±1.0%	±0.5%
LOW SPEED VOLTAGE DROP PROTECTION	Standard	Standard	Standard	Standard	Standard
SHORT-CIRCUITED ELECTRIC ABILITY				300%:10S	300%:10S
PARALLEL OPERATION		Ontional	Ontional	Ontional	Ontional

A.R.K6B
Three Phase Efficiency Curves (WINDING 311) 50HZ

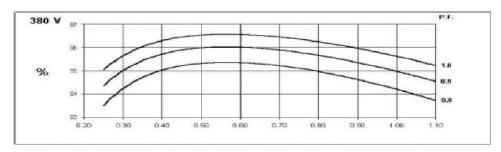


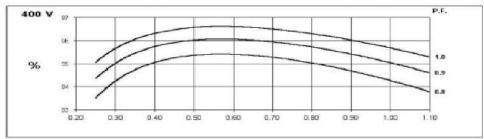


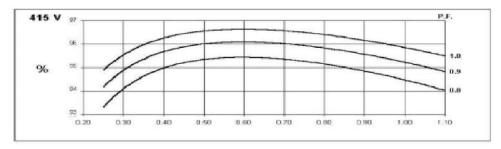


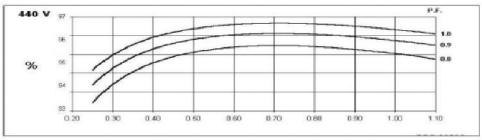


A.R.K6B
Three Phase Efficiency Curves (WINDING 311) 60HZ

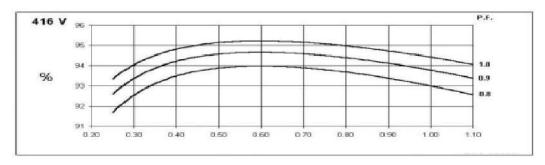


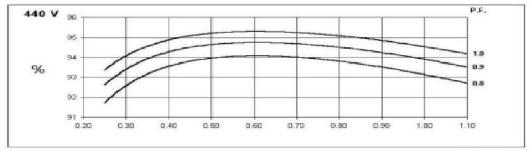


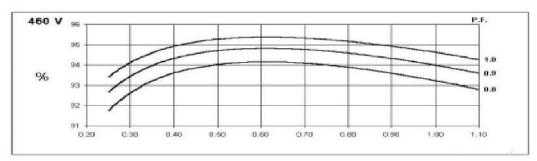

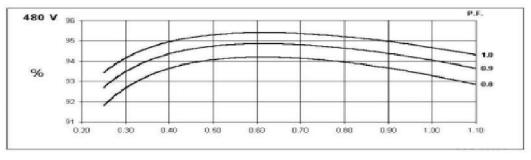


A.R.K6B Locked Rotor Motor Starting Curve (Winding 311)

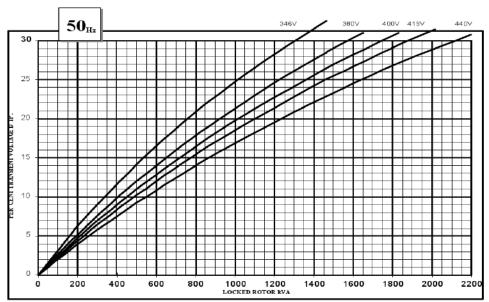


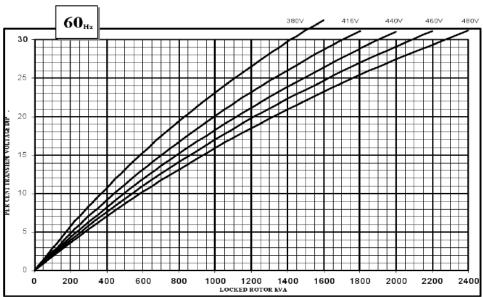

A.R.K6B Three-phase Short Circuit Decrement Curve. No-load Excitation at Rated Speed Based on star (wye) connection.

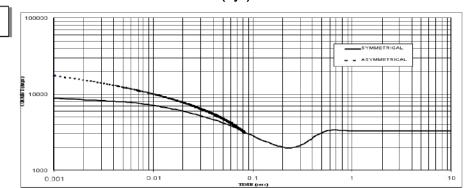

Sustained Short Circuit = 3,250 Amps

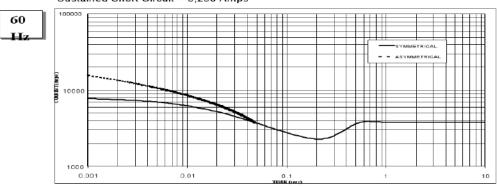

Sustained Short Circuit = 3,800 Amps

1. The following multiplication factors should be used to adjust the values from curve between time 0.001 seconds and the minimum current point in respect of nominal operating voltage

	50HZ	60HZ					
Voltage	Factor	Voltage	Factor				
380V	X 1.00	416V	X 1.00				
400V	X 1.05	440V	X 1.06				
415V	X 1.09	460V	X 1.10				
440V	X 1.16	480V	X 1.15				

The sustained current value is constant irrespective of voltage level

2.The following multiplication factor should be used to convert the values calculated in accordance with NOTE 1 to those applicable to the various types of short circuit

3-phase 2-phase L-L 1-phase L-N Instantaneous x 1.00 x 0.87 x 1.30 Minimum x 1.00 x 1.80 x 3.20 x 1.50 x 2.50 x 1.00 Sustained Max. sustained duration 10 sec. 5 sec 2 sec

All other times are unchanged

50

3.Curves are drawn for Star (Wye) connected machines.


For other connection the following multipliers should be applied to current values as shown : Parallel Star = Curve current value X 2

Series Delta = Curve current value X 1.732

A.R.K6B Winding 311 / 0.8 Power Factor RATINGS

	Class - Temp Rise		Cont. F -	105/40°C			Cont. H -	125/40°C			Standby -	150/40°C		•	Standby -	163/27°C	
	Series Star (V)	380	400	415	440	380	400	415	440	380	400	415	440	380	400	415	440
	Parallel S tar (V)	190	200	208	220	190	200	208	220	190	200	208	220	190	200	208	220
50HZ		220	230	240	254	220	230	240	254	220	230	240	254	220	230	240	254
30112	kVA	651	687	687	623	710	750	750	680	755	800	800	755	780	825	825	780
	kW	521	550	550	498	568	600	600	544	604	640	640	604	624	660	660	624
	Efficiency (%)	93.6	93.6	93.8	94.2	93.2	93.3	93.5	94	93.1	93.1	93.3	94	93	93	93.3	93.9
	Class - Temp Rise		Cont. F -	105/40°C			Cont. H -	125/40°C			Standby -	150/40°C			Standby -	163/27°C	
	Series Star (V)	416	440	460	480	416	440	460	480	416	440	460	480	416	440	460	480
	Parallel S tar (V)	208	220	230	240	208	220	230	240	208	220	230	240	208	220	230	240
60HZ		240	254	266	277	240	254	266	277	240	254	266	277	240	254	266	277
UUNZ	kVA	742	784	820	860	810	855	895	938	840	889	929	970	849	898	939	980
	kW	594	627	656	688	648	684	716	750	672	711	743	776	679	718	751	784
	Efficiency (%)	93.3	93.5	93.6	93.6	93	93.1	93.2	93.3	92.8	93	93.1	93.1	92.8	92.9	93	93.1

DIMENSIONS

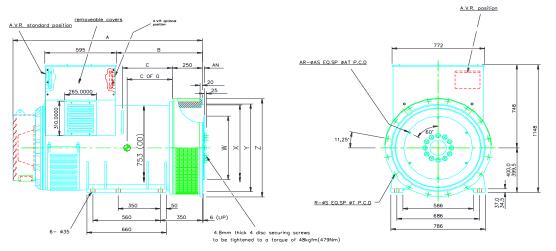

UNIT: (MM)

MODEL	Α	В	С	KVA	C OF G	
6B	1308			750	577	ŀ
6C				800	591	ŀ
6D	1578	726	405	910	597	L
6E				1000	607	
6F				1125	625	
6G	1679	826	464	1250	735	

ADAPTOR	Χ	Υ	Z	N	R	S	Т
SAE00	768	787.3	883	16	12	14	851
SAEO	621	647.6	810	16	16	14	679.5
SAE0.5	568	584.1	810	12	12	14	619

COUPLING DISC	W	AN	AR	AS	ΑT
SAE24	733.3	0	12	20.7	692
SAE21	673.02	0	12	16.7	641.3
SAE18	571.42	15.87	6	16.7	543.0
SAE14	466.64	25.40	8	13.5	438.1